



# CITY OF MOUND WATERMETER/SUMP PUMP INSTALLATION

1. METERS MUST BE MOUNTED HORIZONTAL, NO HIGHER THEN 14" OFF FLOOR. NO LESS THEN 6" OFF FLOOR
2. METERS MUST BE ACCESSIBLE FOR SERVICE AND MANUAL READINGS
3. METERS MUST HAVE SUITABLE SHUT-OFF VALVES DIRECTLY ON BOTH SIDES. THIS IS FOR REPAIRS AND OR REMOVAL
4. METERS MUST HAVE ELECTRICAL GROUNDING STRAP CONNECTED ACROSS THE METER OPENING TO BOTH SIDE PIPES. THIS PROTECTS THE OPERATOR WHENEVER REPAIRS OR METER REMOVAL IS REQUIRED.
5. NO METER "HORN'S" ALLOWED.

## DEDUCT METER INSTRUCTIONS

1. FOLLOW ABOVE INSTRUCTIONS 1-4.
2. METER MUST BE INSTALLED INSIDE THE HOME WITH ACCESS TO WIRE DEDUCT METER TO HOME METER.

## CORRECT

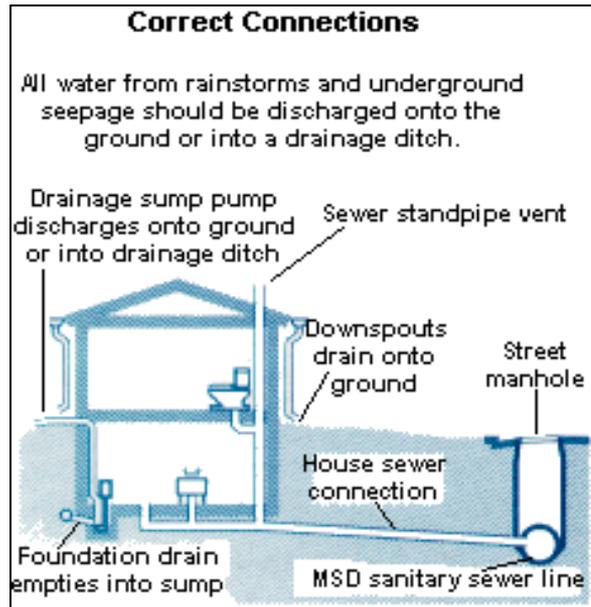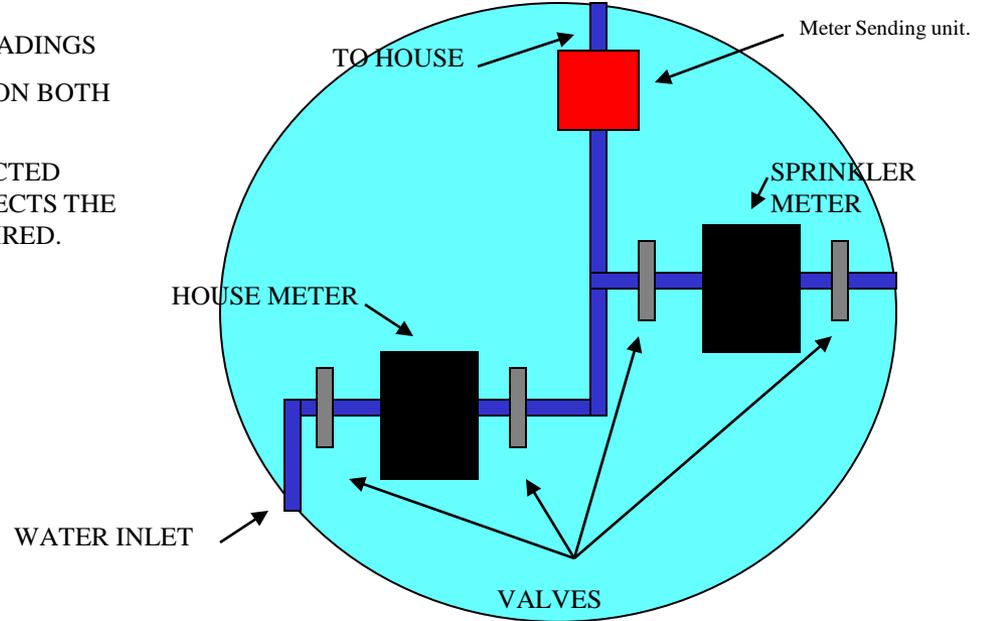

## SUMP PUMP INSTALLATION

\*All Plumbing must meet city code\*

## WRONG

